



CHINA QUALITY CERTIFICATION CENTRE CERTIFICATE OF CONFORMITY

Certificate No.: CE210303007417

Product

Moulded Case Circuit-breaker

Applicant

Zhejiang Tengen Electric Co.,Ltd.

Sulv Industrial Area, Liushi Town, Yueqing City, Zhejiang Province, P.R.China

Type/Model

TGB1N-125,TGB1N-125M,TGB1N-125H,TGBD-125,TGBD-125H,TGBH-125,
TGBH-125H,TGBK-125,TGBK-125H,TGBG-125,TGBG-125H,TGBG-125A,TGBG-125HA;

Technical data

See the Appendix

This is to certify that, on the basis of the tests undertaken as per Report No. CE-045-1C212723, the submitted sample(s) of the above item complies with:

EN 60947-2:2017/A1:2020;EN 60947-2:2017

and fulfills testing requirements of the European Directive:

2014/35/EU

This report is to verify the compliance of the sample submitted by the manufacturer only, and does not include the manufacturing process. Users shall affix the mark in accordance with the related legislation.

Valid from: Oct.20,2021

Valid until: Oct.20,2024

The certificate information is available through the QR code below or CNCA's website: www.cnca.gov.cn



SIGNATURE:

谢肇煦



CHINA QUALITY CERTIFICATION CENTRE





CHINA QUALITY CERTIFICATION CENTRE CERTIFICATE OF CONFORMITY

Appendix

Page 1 of 2

Certificate No.: CE210303007417

TGB1N-125,TGB1N-125M,TGB1N-125H,TGBD-125,TGBD -125H,TGBH-125,
TGBH-125H,TGBK-125,TGBK-125H,TGBG-125,TGBG-125H,TGBG-125A,TGBG-125HA;
TGB1N-125,TGB1N-125M,TGB1N-125H,TGBD-125,TGBD -125H,TGBH-125,TGBH-125H
Ue:AC220V/230V/240V(1P/1P+N /2P),AC380V/400V/415V(2P,3P,3P+N,4P);

Ui:690V; Uimp:4kV;

In:63A,80A,100A,125A;

Selectivity Category: A;

Over-current Trip Unit: Thermo-magnetic;

TGB1N-125,TGB1N-125M,TGBD-125,TGBH-125:Icu=Ics:6kA;

AC220V/230V/240V(2P):Icu:10kA,Ics:7.5kA;TGB1N-125H ,

TGBD-125H,TGBH-125H:Icu:10kA ,Ics:7.5kA;

50/60Hz;1P,

1P+N,2P,3P,3P+N,4P;

TGBK-125,TGBK-125H,TGBG-125,TGBG-125H,TGBG-125A,TGBG-125HA

Ue:AC220V/230V/240V(1P/1P+N/2P),AC380V/400V/415V(2P/3P/3P+N/4P);DC60V/110V/125V
(1P),125V/220V/250V(2P),330V/375V(3P),440V/500V(4P);

Ui:690V;Uimp:4kV;

In:63A,80A,100A,125A;

Selectivity Category: A;

Over-current Trip Unit: Thermo-magnetic;

TGBK-125,TGBG-125,TGBG-125A:AC Icu=Ics:6kA;

AC220V/230V/240V(2P):Icu:10kA,Ics:7.5kA;DC60V

(1P),125V(2P):Icu:20kA ,Ics:15kA;DC110V/125V(1P),220V/250V(2P),330V/375V(3P),440V/500
V(4P): Icu=Ics:10kA;



CHINA QUALITY CERTIFICATION CENTRE






CHINA QUALITY CERTIFICATION CENTRE CERTIFICATE OF CONFORMITY

Appendix

Page 2 of 2

Certificate No.: CE210303007417

TGBK-125H,TGBG-125H,TGBG-125HA:AC Icu:10kA ,Ics:7.5kA;DC60V (1P),125V
(2P):Icu:20kA ,Ics:15kA;DC110V/125V(1P),220V/250V(2P),330V/375V(3P),440V/500V(4P):Icu=
Ics:10kA;
50/60Hz;
AC 1P,1P+N,2P,3P,3P+N,4P;DC 1P,2P,3P,4P;
Applicable for isolation;

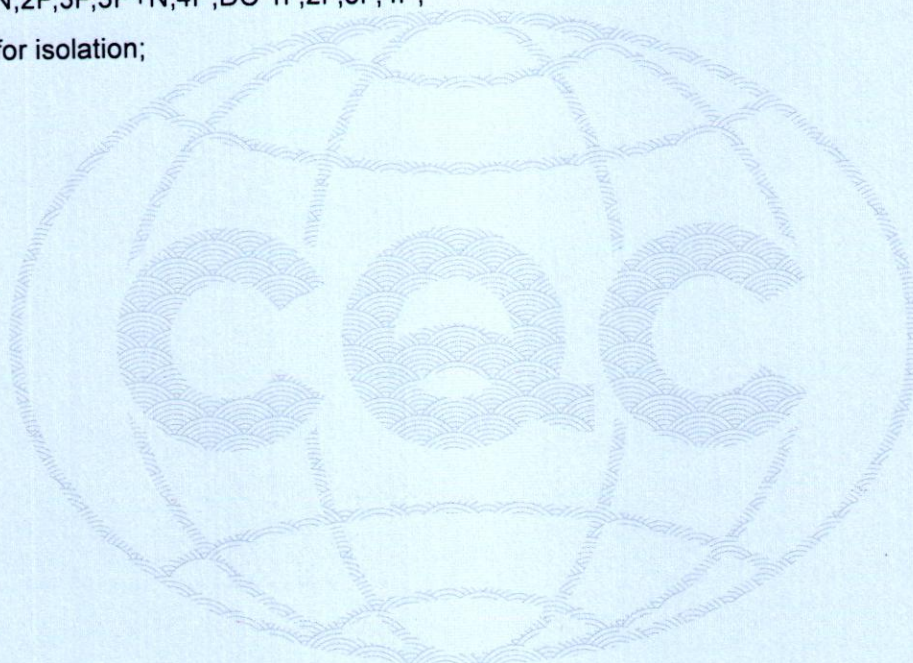

CHINA QUALITY CERTIFICATION CENTRE

